

Global Energy Policy Research | GEPR

GEPR <http://agorajp.com/>

???

?? · Wednesday, September 12th, 2018

3


???

50Hz 47.5Hz (UFR)

???

3 25 17 1 29 kW

3 25 1 35 kW

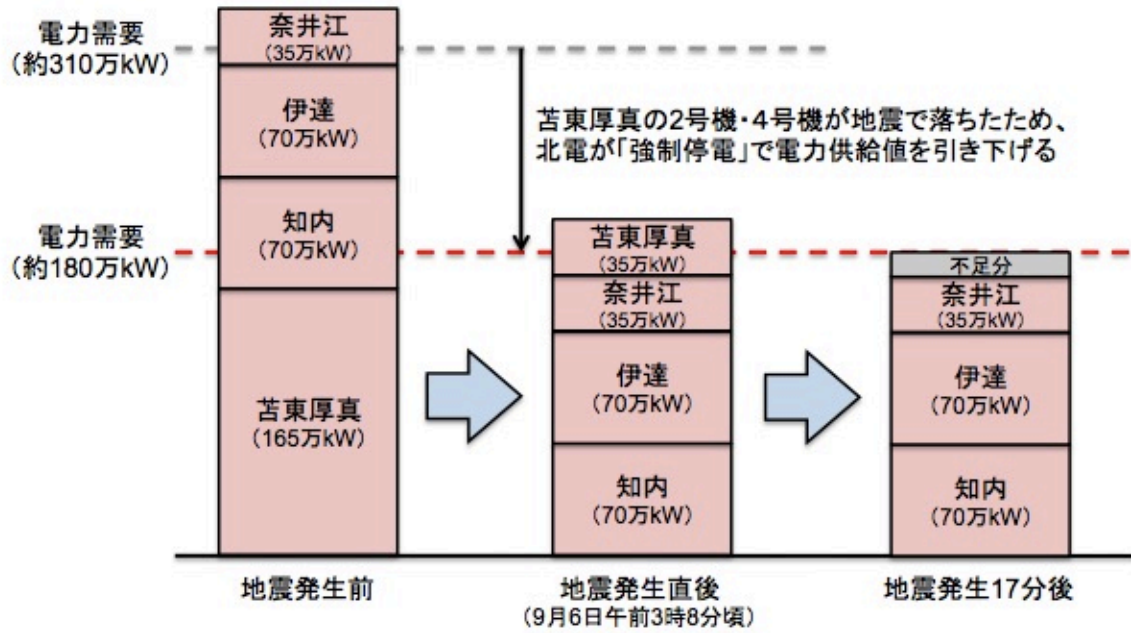

1. 地震で苦東厚真2号機・4号機(出力: 130万kW)の運転が停止
2. 130万kW分の供給不足が生じたため、北電は強制停電を敢行
3. 地震から17分後、苦東厚真1号機が(出力: 35万kW)の運転が停止
4. 北電に不足分を埋める余力がなかったため、ブラックアウトが発生

????????1??180?kW????????????????207?kW????????????????????
 ?????300?kW??

??3??24??1????????????????????2????????????1????35?kW????????????????2????????????????
 ?????????????????????

??
 ?????????????????????

?????????????????25?kW?????????????????????580?kW????????????????165?kW?????????????????415?kW?????
 ?????????????????

This entry was posted on Wednesday, September 12th, 2018 at 1:00 pm and is filed under ??????????,
 ???

You can follow any responses to this entry through the [Comments \(RSS\)](#) feed. Both comments and pings are currently closed.